



ARYA INSTITUTE OF ENGINEERING & TECHNOLOGY

ENERGY AUDIT REPORT

2022 - 2023

PREPARED BY
EHS ALLIANCE SERVICES





SHZJHZOU

AU	DIT CERTIFICATE	2
AC	KNOWLEDGEMENT	3
DI	SCLAIMER	4
AB	BREVIATION	5
IN'	TRODUCTION OF COLLEGE	6
ΑU	DIT PARTICIPANTS	10
EX	ECUTIVE SUMMARY	11
EN	ERGY AUDIT ANALYSIS	11
1.	ENERGY CONSUMPTION	11
2.	DIESEL CONSUMPTION	13
3.	ANALYSIS OF DG SETS	14
4.	AC SYSTEMS	16
5.	CEILING FANS ANALYSIS	17
6.	ANALYSIS OF LIGHTING SYSTEM	18
	6.1. BRIEF DESCRIPTION	18
	6.2. INVENTORY OF LIGHTING	18
	6.3. LUX MEASUREMENT	19
7.	OTHER POWER CONSUMPTION	20
	7.1 INVENTORY OF IT INFRASTRUCTURE	20
	7.2 PUMP DETAILS	23
	7.3 EXHAUST FAN DETAILS	23
8	CAPACITOR BANK	24





CERTIFICATE



CERTIFICATE

PRESENTED TO

ARYA INSTITUTE OF ENGINEERING & TECHNOLOGY

SP-40, Kukas, RIICO Industrial Area, Delhi Road, Jaipur -302028, Rajasthan

Has been assessed by EHS Alliance Services for the comprehensive study of Energy Audit on institutional working framework to fulfill the requirement of

ENERGY AUDIT

ACADEMIC YEAR 2022-23

The energy-saving initiatives carried out by the institution have been verified in the report submitted and were found to be satisfactory.

The efforts taken by management and faculty towards all types of energy used in the institution and sustainability are highly appreciated and noteworthy.



10.04.2023 DATE OF AUDIT

EHS ALLIANCE SERVICES, PLOT A-72, SURYA VIHAR, GURUGRAM, 122001 WWW.EHSALL.IN | BUSINESS@EHSALL.IN | EHSALLIANCE@GMAIL.COM





ACKNOWLEDGEMENT

EHS Alliance Services would like to thank the management of Arya Institute of Engineering & Technology for assigning this important work of Energy Audit. We appreciate the co-operation to the teams for completion of assessment.

We would also like to thank *Dr. Pramod K. Sharma- Audit Coordinator*, for his continuous support and guidance, without which the completion of the project would not have been possible. We are also thankful to other staff members who were actively involved while collecting the data and conducting field measurements.

We are also thankful to

Er. Kshitiz Agarwal - IQAC Director

Er. Sandeep Jhamb - H.O.D. Mechanical Engineering

Mr. Rajesh Jaiswal - Estate Manager

Mr. Devendra Kumar Badiwal - Accountant

Last but not the least, we would like to thank *Dr. Himanshu Arora- Principal and Dr. Arvind Agarwal, President of Society* for giving us an opportunity to evaluate the environmental performance of the campus.





DISCLAIMER

EHS Alliance Services Energy Audit Team has prepared this Energy Audit Report for Arya Institute of Engineering & Technology based on input data submitted by the representatives of college complemented with the best judgment capacity of the expert team.

While all reasonable care has been taken in its preparation, details contained in this report have been compiled in good faith based on information gathered.

It is further informed that the conclusions are arrived following best estimates and no representation, warranty or undertaking, express or implied is made and no responsibility is accepted by Audit Team in this report or for any direct or consequential loss arising from any use of the information, statements or forecasts in the report.

If you wish to distribute copies of this report external to your organization, then all pages must be included.

EHS Alliance, its staff and agents shall keep confidential all information relating to your organization and shall not disclose any such information to any third party, except that in the public domain or required by law or relevant accreditation bodies. EHS Alliance staff, agents and accreditation bodies have signed individual confidentiality undertakings and will only receive confidential information on a 'need to know' basis.

Scott

Vijay Singh Lead Auditor EMS & Energy BER

Dr. Uday Pratap Co-Auditor EMS & Energy





ABBREVIATION

A Amps

AC Air Conditioner

AC Alternating Current

AMET Academy of Maritime Education and Training

CFL Compact fluorescent lamp

CIP Comprehensive Inspection Programme

DC Direct Current

HSD High Speed Diesel

Hz Hertz

kg Kilogram

kVA kilo-volt-ampere

kW kilo Watts

kWh kilowatt hour

kWp Kilowatt peak

LED Light Emitting Diode

LPG Liquefied Petroleum Gas

MMS Module mounting structure

MPPT Maximum Power Point Tracker

NAAC The National Assessment and Accreditation Council

SEC Specific Energy Consumption

SPV Solar Photovoltaic

STC Standard Test Condition

TV Television

V Volts

W Watts

W/m2 watt per square metre





OVERVIEW OF THE COLLEGE

Arya Institute of Engineering & Technology (AIET) is amongst the foremost of Top Institutes in Rajasthan for Engineering in Higher Technical Education & Research. Established in the year 2005, in the State of Rajasthan, Arya Institute of Engineering & Technology has evolved into the most prominent College in the state as well as the Best Engineering Colleges in Jaipur. Spread over 5 acres of land, its highly skilled faculties are imparting education and guidance to thousands of students in a multi-faceted environment comprising of various Teaching Departments on its Campus. Since its establishment, the Institute has played a vital role in providing the best technical manpower and know-how to the country.



Arya Institute of Engineering & Technology (AIET) is amongst the foremost of Top Institutes in Rajasthan for Engineering in Higher Technical Education & Research. Established in the year 2005, in the State of Rajasthan, Arya Institute of Engineering & Technology has evolved into the most prominent College in the state as well as the Best Engineering Colleges in Jaipur. Spread over 5 acres of land, its highly skilled faculties are imparting education and guidance to thousands of students in a multi-faceted environment comprising of various Teaching Departments on its Campus. Since its establishment, the Institute has played a vital role in providing the best technical manpower and know-how to the country.





MISSION, VISION & VALUES

MISSION

- ✓ To create a Progressive Academic Environment by nurturing the Creativity, Ideas, Innovation and Skills in Students in order to achieve Qualitative Techno-Managerial Skills.
- ✓ To provide Excellent Ambience to enhance the Teaching-Learning processes amongst Students and Faculty members by building a determined team who are committed to the ideas of Integrity, Positive Thinking and Social Development to meet industry expectations and requirements.
- ✓ To make Students Globally Competitive by providing suitable Training, Value Added Certification Courses and Beyond Syllabus Academics in order to generate capacity to face competitions and placements and become imaginative mastermind and inventive issue solver while providing them safe and challenging environment.

VISION

To emerge as the best educational institute and Work for Excellence in imparting quality education to the students to nurture their inherent talent as Innovative Professional in technical and managerial field there by making them competitive to meet all the future challenge of global economy..

VALUES

Create an environment that instills professionalism, integrity, and the highest professional commitment to the students

Facilities in the campus

Amenities at Arya Institute of Engineering & Technology (AIET) provide far more than academic and administrative facilities on campus. It is dedicated to provide students with an exceptional infrastructure for learning as well as facilities for simplifying the procurement of fundamental skills. To accomplish the goal, AIET offers the following:

GREEN CAMPUS: The Institute has an impressive and pollution-free campus with panoramic green surroundings, elegant landscaping and beautiful flowerbeds.

TRANSPORT: The institute runs its own fleet of buses and Cabs for the convenience of the students and the staff members to help them commute from Jaipur and surrounding areas.





The students intending to avail the transport facility need to inform the transport officer at the time of admission.





SPORTS ACTIVITIES: Spending quality time is never a problem in the Institute. Sports facilities are provided for Lawn tennis, Table tennis, Carom, Billiards Table, Cricket, Football, Badminton, Basketball, and Volleyball. Evenings find students enjoying the pleasure of these sports as players and audience.





MESS: The institute has its huge mess, which serves healthy and nutritious cuisines to its students.

CANTEEN: The institute has its own canteen, which serves healthy and nutritious food to its students at subsidized rates. The menu varies from spicy samosas, wafers to full-meals. The students also have a wide range of chocolates and soft drinks to choose from.

WATER & ELECTRICITY: The institute has complete arrangements to deliver uninterrupted water and electricity supply for the students, round the clock. Sufficient water coolers with filtered water are available throughout the campus to provide clean drinking water to the students. In case of power failures, high power generators are also available. Constant monitoring is carried out to ensure that cleanliness is given utmost importance.

HEALTH: Health is wealth. Keeping this in mind regular health checkup Camps are organized in the campus to examine the health of students and staff members. Acquisition of health





related knowledge, attitudes, skills and practices empower students to pursue a healthy life. The energetic students take full advantage of every opportunity to learn and thus achieve higher - academic excellence & tend to maximize social relationships and interactions, thus improving their chances of balanced progress.

MEDICAL: Each hostel is provided with necessary first aid facilities. The Institute provides free first aid to the students in college campus during working hours. Qualified physicians are available in the close proximity of the college & hostels for consultancy.





CAFETERIA



AUDITORIUM



WELL EQUIPED GYMS



Geo Location Geo Coordinates from Google maps: 27.0299119, 75.8913942







AUDIT PARTICIPANTS

On behalf of college

Name	Designation
Dr. Arvind Agarwal	President of Society
Dr. Himanshu Arora	Principal
Dr. Pramod K. Sharma	Audit Coordinator
Er. Kshitiz Agarwal	IQAC Director
Er. Sandeep Jhamb	H.O.D. Mechanical Engineering
Mr. Rajesh Jaiswal	Estate Manager
Mr. Devendra Kumar Badiwa	l Accountant

On behalf of EHS Alliance Services

Name	Position	Qualifications
Mr. Vijay Singh	Lead Auditor	M.Sc. M. Tech (Environment Science & Engineering), Energy Auditor, Post Diploma in Industrial Safety Management
Dr. Uday Pratap	Co-Auditor	Ph.D., EMS: Lead Auditor ISO14001:2015, QCI–WASH







EXECUTIVE SUMMARY

The purpose of this Energy Audit was to seek opportunities to improve the energy efficiency of the Arya Institute of Engineering & Technology. Reducing the energy consumption despite improving the human comfort, health and safety were of primary concern.

Beyond just identifying the energy consumption pattern, this audit sought to detect and categorize the most energy efficient appliances. Additionally, some daily practices relating common appliances have been shared which may help reducing the energy consumption. Data collection for energy audit of the campus was carried out by the EHS Alliance Team. The Energy Audit Report accounts for the energy consumption patterns of the institution on actual survey and detailed analysis during the audit.

The work comprehends the area wise consumption traced using suitable equipment. The analysis was carried out by our team with the support of the staff members from Arya Institute of Engineering & Technology. The report provides a list of possible actions to preserve and efficiently access the available source, resources and their saving potential was also identified. We look forward towards optimization that the authorities, students and staff members would follow the recommendations in the best possible way. The report is based on certain generalizations including the approximations wherever necessary. The views conveyed may not reveal the general opinion. They merely represent the opinion of the team guided by the interviews of clients. We are happy to submit this Energy audit report to the Arya Institute of Engineering & Technology.

ENERGY AUDIT - ANALYSIS

1. ENERGY CONSUMPTION

To understand the Energy Consumption trends and for analyzing the average monthly consumption we have collected electricity energy bills from March 2022 to February 2023

The details of "Meter Connection" at "Arya Institute of Engineering & Technology" are as follows-






Name - ALL INDIA ARYA SAMAJI SOCIETY FOR HIGHER TECH EDUCATION

CA No. - 210524027388

1.1 Summary of Monthly Electricity Consumption and Total Bill Amount


To understand the Energy consumption trend and for developing the baseline parameter we have collected monthly energy bill for the 12 months i.e. from March 2022 to February 2023

Month	Grid Units	Amount	Solar Units	Total Units	Amount
Mar-22	21884	8.00	19592	41476	331808
Apr-22	21386	8.00	23386	44772	358176
May-22	30046	8.00	22122	52168	417344
Jun-22	38838	8.00	22549	61387	491096
Jul-22	24680	8.00	19616	44296	354368
Aug-22	36396	8.00	17051	53447	427576
Sep-22	35970	8.00	19312	55282	442256
Oct-22	22026	8.00	21328	43354	346832
Nov-22	21440	8.00	17152	38592	308736
Dec-22	18078	8.00	15202	33280	266240
Jan-23	21386	8.00	6214	27600	220800
Feb-23	18088	8.00	9182	27270	218160
SUM	310218		212706.00	522924	4183392

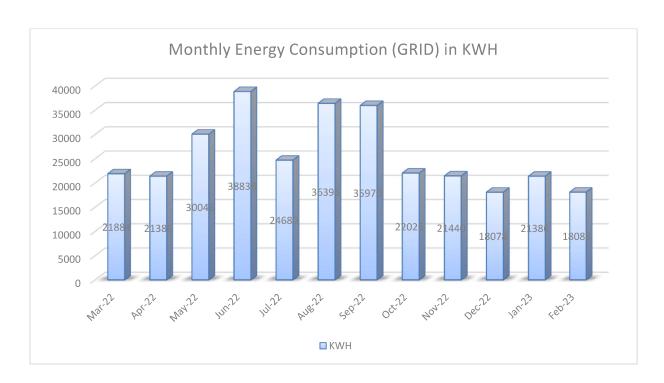





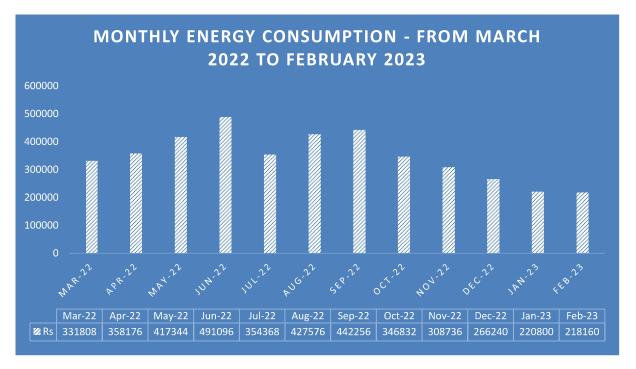


2. DIESEL CONSUMPTION

Below is the diesel consumption details in litres from from March 2022 to Feb 2023.

Period	Diesel consumption (in litres)
Mar-22	3179
Apr-22	4854
May-22	3018
Jun-22	3112
Jul-22	3320
Aug-22	3746
Sep-22	3806
Oct-22	3340
Nov-22	2972
Dec-22	2985
Jan-23	3352
Feb-23	2690
Total	40374





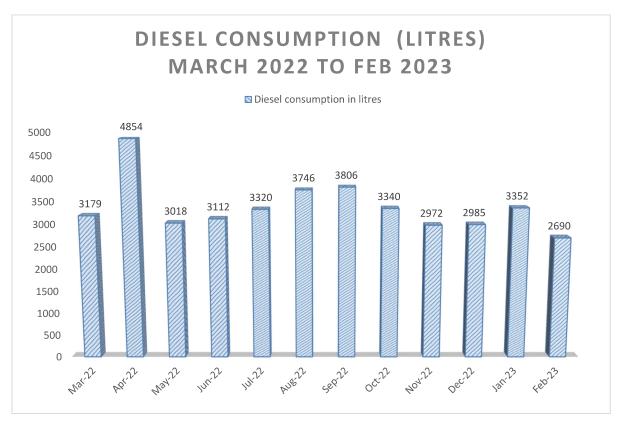

3. ANALYSIS OF DG SETS

In the campus, there is only one Diesel Generator (DG) set for its electrical power needs in case of Grid power failure. DG sets capacity is 250 kVA.

DG Set Design Details								
Description	Unit	DG at Station 1						
Rated capacity	kVA	250						
Hz		50						
Sl No.		3306081004174						
Make		Greaves						
Volts	Volts	415						
PF		0.8						
Phase		3						
RPM		1500						
Amps	Amps	448						
Mfg.		2006						





DG Set Operation details								
Operating hours during testing	Hours	0.50						
% Loading	%	62.71						
Energy Generation	kWh	33.64						
Load	kVA	91.74						
Fuel consumption during testing	Litre	9						
Specific energy generation	kWh/litre	3.19						

Observation and Suggestions:-

Soundproof silent generators are an efficient tool to keep both noise and vibration at low levels. For the power backup of the institution, the soundproof model is installed in the institution.

As per the trial taken during the energy audit the percentage loading of DG set is 62.71% which is ok and specific energy consumption of DG Sets 3.19 kWh/Litre which is satisfactory because as per manufacturer recommendation, best practices for SEC in DG sets range from 3.0 to 3.5 kWh/Litre and above.

We recommend college to initiate stack monitoring of DG set through authorized lab.







4. AC SYSTEM

Energy Efficiency Ratio (EER): Performance of smaller chillers and rooftop units is frequently measured in EER rather than kW/ton. EER is calculated by dividing a chiller's cooling

Capacity (in Btu/h) by its power input (in watts) at full-load conditions. The higher the EER, the More efficient the unit. The cooling effect produced is quantified as tons of refrigeration (TR). The above TR is also called as air-conditioning tonnage.

There are Split ACs installed in Arya Institute of Engineering & Technology in various areas of various capacity which detail is given below:-

SI No.	Location/Identification	Type(Window/Split)	Qty	RR. Tonnage	Room Temp. (°C)	AC-Tout (°C)	AC-Tin (°C)	Room-RH (%)	Area (m2)	Air velocity (m/s)	Enthalpy Hout	Enthalpy Hin	Heat Load in TR	KW supplied	(Eff.) Power per Ton (KW /TON)	EER
1	Ground Floor	S	10	2	24	12	20	52	0.03	2.2	25	38	0.3	0.6	1.7	2
2	Ground Floor	S	1	2	24	11	19	52	0.03	2.6	24	37	0.4	0.6	1.5	2.3
3	Ground Floor	W	13	1.5	24	10	18	52	0.03	2.4	24	37	0.4	0.5	1.5	2.3
4	First Floor	S	7	1.5	23	12	20	52	0.03	2.3	25	38	0.3	0.6	1.7	2.1
5	First Floor	W	8	1.5	24	12	20	52	0.03	2.2	25	38	0.3	0.6	1.7	2
6	Second Floor	S	2	1.5	24	11	19	52	0.03	2.6	24	37	0.4	0.6	1.5	2.3
7	Second Floor	W	10	1.5	24	10	18	52	0.03	2.4	24	37	0.4	0.5	1.5	2.3
8	Third Floor	S	4	2	23	12	20	52	0.03	2.3	25	38	0.3	0.6	1.7	2.1
9	Third Floor	S	2	2	24	12	20	52	0.03	2.2	25	38	0.3	0.6	1.7	2
10	Third Floor	W	12	1.5	24	11	19	52	0.03	2.6	24	37	0.4	0.6	1.5	2.3
11	Robo lab	W	2	1.5	24	10	18	52	0.03	2.4	24	37	0.4	0.5	1.5	2.3
12	Library	W	1	1.5	23	12	20	52	0.03	2.3	25	38	0.3	0.6	1.7	2.1

Remarks: - We have checked Energy Efficiency Ratio of AC's and EER of AC's is fairly OK. But in future you should purchase 5-Star rated invertor based split AC's because power consumption of Inverter based BEE 5-Star rated AC's is less than non-star rated AC's.

Also, we recommend Arya Institute of Engineering & Technology to organize periodic maintenance schedule and take corrective actions for insulating of AC's refrigerant lines in order to protect energy losses.









5. FANS ANALYSIS

In the Arya Institute of Engineering & Technology, there are 1018 fans installed, all are ceiling fans of 60W. The observation and suggestion are given below.

Sl No.	Location/Identification	Ceiling Fan-60W
1	Basement Lab 1	6
2	Basement Lab 2	6
3	Basement Lab-3	6
4	Basement Lab -4	6
5	Basement Lab -5 GSS	6
6	Basement Lab 6 (PE)	6
7	Basement Drive Lab	6
8	Basement Lab -CSE	4
9	Basement - Project Lab	6
10	Basement HVE Lab	6
11	Ground Floor	120
12	First Floor	99
13	Second Floor	120
14	Third Floor	141
15	NBH	253
16	Tej Hostel	178
17	Robolab	9
18	Library	40





Total no of Ceiling Fans (60W)	=	1018	Nos.
Total wattage of 60W Ceiling Fans	=	61080	Watt
Total wattage of BEE 5 Star rated Fans (30W)	=	30540	Watt
Total saving in Wattage after replacement	=	30540	Watt
Operating hours per day	=	8	Hours
Operating days per annum	=	283	Days
Energy charges per unit in Rs.	=	8.0	INR
Saving in Rs./annum	=	551510.4	INR
Investment INR	=	2443200	INR
Payback period	=	4.43	Years

Observation and Suggestions:-

In the college, all the ceiling fans are of 60 W but BEE 5 Star Rated of 30W Ceiling Fans are present in the market. We recommend to replace existing fans to BEE 5 Star rated 30W fans.

Note:- Energy saving will increase or decrease if operating hours of machine /equipment will be increased or decreased and payback period will also increase or decrease if cost of investment (Cost of machine/equipment/accessories of machine) will increase or decrease because cost of investment is taken on tentative basis.

6. ANALYSIS OF LIGHTING SYSTEM

6.1 Brief description of existing system

For assessing energy efficiency of lighting system, Inventory of the Lighting System has been noted / collected, with the aid of a lux meter, measurement and documentation of the lux levels at various locations at working level has been done.





6.2 Inventory of Lighting

Sl. No.	Location/Identification	200W- LED High Mast	10W LED	18W LED Light	12 W LED Round	36W Tube light	18W LED Flood	20W LED
1	Basement	0	0	25	0	60	0	0
2	Ground Floor	0	0	32	0	48	40	13
3	First Floor	0	0	35	0	40	0	25
4	Second Floor	0	0	30	0	47	0	10
5	Third Floor	0	0	80	0	25	0	0
6	Main Gate	2	0	5	0	0	7	0
7	NBH Hostel	4	131	200	0	195	0	0
8	Tez Hostel	2	69	150	0	50	0	0
9	Robolab	0	0	0	0	18	0	0
10	Library	0	0	24	96	2	0	0

6.3 Lux Measurement

Description	Lux	Remark
Class Rooms	120 to 235	Acceptable
Offices	130 to 240	Acceptable
Corridors	35 to 90	Acceptable
Washrooms	45 to 76	Acceptable
Outdoor	36 to 95	Acceptable
Computer Lab	150 to 289	Acceptable
Parking area	45 to 94	Acceptable
Canteen	69 to 185	Acceptable

Observation

College has initiated LED based lighting solution, but still there are 485 (36W) tube lights. LEDs save energy, the life span is much greater and emit virtually no heat. We recommend to replace the tube lights with LEDs.

Additionally, we recommend to install motion sensor-based lights in common areas such as library, washrooms, corridors, etc.





We also recommend to use solar lights for open areas like parking, ground, street lights, etc. and motion sensor lights for common areas such as library, corridors, washrooms, etc. Table below shows the performance characteristics comparison of all luminaries.

Table - Luminous Performance Characteristics of Commonly Used Luminaries								
Type of Lamp	Lumens/Watt		Colour	Typical Application	Typical Life			
	Range	Avg.	Rendering Index					
Incandescent	8-18	14	Excellent (100)	Homes, restaurants, general lighting emergency lighting	1000			
Fluorescent lamps	46-60	50	Good w.r.t coating (67- 77)	Offices, shops, hospitals, homes	5000			
Compact fluorescent Lamps (CFL)	40-70	60	Very Good (85)	Hotels, shops, homes, offices	8000-10000			
High pressure mercury (HPMV)	44-57	50	Fair (45)	General lighting in factories, garages, car parking. flood lighting	5000			
Halogen lamps	18-24	22	Excellent (100)	Display, flood lightening, stadium exhibition grounds, construction areas	2000 - 4000			
High pressure sodium (HPSV) SON	67-121	90	Fair (22)	General lighting in ware houses, factories, street lighting	6000 - 12000			
Low pressure sodium (LPSV) SOX	101-175	150	Poor (10)	Roadways, tunnels, canals, street lighting	6000 - 12000			
Metal halide lamps	75-125	100	Good (70)	Industrial bays, spot lighting, flood lighting, retail stores	8000			
LED Lamps	30-50	40	Good (70)	Reading lights, desk lamps, night lights, spotlights, security lights, signage lights, etc.	40000 - 100000			





7. OTHER POWER CONSUMPTION

7.1 Inventory of IT Infrastructure

No. Registrar Office 6 2 2 1 2 Account Office 6 0 2 0 3 Robotic Lab 1 6 1 1 0 4 Robotic Lab 2 2 0 0 0 5 T&P Office 4 1 3 0 6 Exam Cell 7 1 2 0 7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 15 CSE Staff Room 7 0 0 0 16 SDC Cell 4 0 1 0	0 0 0 0	0 0 0
2 Account Office 6 0 2 0 3 Robotic Lab 1 6 1 1 0 4 Robotic Lab 2 2 0 0 0 5 T&P Office 4 1 3 0 6 Exam Cell 7 1 2 0 7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0 0 0	0
3 Robotic Lab 1 6 1 1 0 4 Robotic Lab 2 2 0 0 0 5 T&P Office 4 1 3 0 6 Exam Cell 7 1 2 0 7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 15 CSE Staff Room 7 0 0 0	0	0
4 Robotic Lab 2 2 0 0 0 5 T&P Office 4 1 3 0 6 Exam Cell 7 1 2 0 7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	
5 T&P Office 4 1 3 0 6 Exam Cell 7 1 2 0 7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0		0
6 Exam Cell 7 1 2 0 7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0		U
7 Admission Cell 1 0 0 0 8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	0
8 Board Room1 1 0 1 0 9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	Photocopy -1
9 Board Room2 2 0 1 0 10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	0
10 TV Studio 2 0 0 0 11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	2 TVs
11 Principal Office 3 1 1 0 12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	1 TV
12 Director Room 5 1 2 0 13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	1 TV
13 Estate Room 1 0 1 0 14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	0
14 CSE Dept 10 0 2 0 15 CSE Staff Room 7 0 0 0	0	1 Photocopy Machine
15 CSE Staff Room 7 0 0 0	0	0
	0	0
16 SDC Cell 4 0 1 0	0	0
	0	0
17 MBA Dept 4 0 1 0	0	0
18 R&D Lab 1 0 0 0	0	0
19 LT-11 1 0 0	0	0
20 Civil Dept 3 0 1 0	0	0
21 3rd Floor 1 0 0 0	0	0





22	EE Dept	4	0	1	0	0	0
23	ME Dept	2	0	1	0	0	0
24	CL12	31	0	0	0	0	0
25	CL13	60	0	0	0	0	0
26	CL-14-A	31	0	0	0	0	0
27	CL-14 B	30	0	0	0	0	0
28	CL-15	30	0	0	0	0	0
29	CL-16	30	0	0	0	0	0
30	CL-17	30	0	0	0	0	0
31	CL-18	30	0	0	0	0	0
32	CL-19	30	0	0	0	0	0
33	CL-20	30	0	0	0	0	0
34	TEZ Lab	30	0	0	0	0	0
35	EE CL	24	0	0	0	0	0
36	ME CL	30	0	0	0	0	0
37	CL-26	40	0	0	0	0	0
38	CL-27	40	0	0	0	0	0
39	CL-28	40	0	0	0	0	0
40	CL-29	40	0	0	0	0	0
41	CL-30	40	0	0	0	0	0
42	CL-31	30	0	0	0	0	0
43	CL-32	50	0	0	0	0	0
44	CL-33	30	0	0	0	0	0
45	CL-34	50	0	0	0	0	0
46	CL-35	50	0	0	0	0	0
	İ			l	<u> </u>		





47	Mechatronics Lab	5	1	4	0	0	0
48	Library	14	0	2	0	0	0
49	President Office	3	1	2	0	0	0
50	Vice President	2	0	2	0	0	0
51	NBH Hostel	3	0	0	0	0	0

7.2 Water pump details

Sr. No.	Description	Unit	Pump No1	Pump No2	Pump No3	Pump No4	Pump No5	Pump No6
1	Rated Power of							
	Motor	KW	7.3x2	2.2	2.2	2.2	1.5	1.5
2	Motor Eff.	%						
3	Discharge Head	m	151	36	50	5	4	4
4	Suction Head	m		10	10	3	3	34
		Submersible/						
5		Monoblok/	Subme	Mono	Mono	Mono	Mono	Mono
	Pump Type	Centrifugal Etc.	rsible	block	block	block	block	block

7.3 Other Loads

Sl No.	Location/Identification	60W Exhaust Fan	160W Exhaust Fan
1	Third Floor -Staff Toilet	1	
2	Third Floor CSE Lab	1	
3	Third Floor CSE Lab17	2	
4	Third Floor CSE -18	2	
5	Third Floor CSE-19	1	
6	Third Floor- Dark Room	2	
7	Third Floor Physics Lab	2	
8	Third Floor Chemistry Lab	1	
9	Third Floor Boys Toilet	1	
10	Girls Toilet	1	
11	LT-41	1	
12	LT-42	2	
13	LT-43	1	
14	LT-45	1	
15	LT-46	1	
16	LT-47	2	
17	Second Floor	13	2
18	First Floor	10	1
19	Ground + Basement	7	8





ANALYSIS

There should be regular maintenance schedule of equipment like pumps, exhaust fans and IT equipment. Electronics such as computers, printers, scanners, etc. more than 3 year or 5 years (as per their life) should be replaced with new computers/laptops. Ideal Temperature should be maintained for all electronic appliances.

8. CAPACITOR BANK

S. No	Capacity in KVAR	Quantity
1	1 KVR	1
2	2 KVR	1
3	5 KVR	1
4	10 KVR	2
5	15 KVR	4
6	20 KVR	2

**** END OF THE REPORT *****